

Metro Water Services

2020 CONSUMER CONFIDENCE REPORT

Metro Water Services is committed to delivering clean, safe, dependable drinking water to all of our customers.

This report details our water quality testing results for 2019. We go above and beyond to meet and exceed all state and federal regulations for drinking water.



INSIDE THIS REPORT

A Message from the Director	3
About the Cumberland River	4
The Water Treatment Process	5
Water Quality Testing	6
2019 Water Quality Data	7
A Message for Vulnerable Populations	8
Preventing Lead in Drinking Water	9
Looking to the Future	10

WHAT IS THE CONSUMER CONFIDENCE REPORT?

Metro Water Services is regulated by the Environmental Protection Agency (EPA) under the Safe Drinking Water Act, which requires community water systems to provide all customers an annual report. This report includes information on our source water, our compliance with drinking water regulations, water quality testing results, and other educational information.

PLEASE SHARE THIS REPORT

Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, or businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.

ESTE INFORME CONTIENE INFORMACIÓN MUY IMPORTANTE SOBRE SU AGUA BEBER. TRADÚZCALO Ó HABLE CON ALGUIEN QUE LO ENTIENDA BIEN.



Throughout your water's journey--from the river to your home and back--Metro Water Services goes above and beyond to ensure the quality and reliability of our services. Look for the Above and Beyond icon throughout this report.

A MESSAGE FROM THE DIRECTOR

COMMITTED TO DELIVERING CLEAN AND SAFE DRINKING WATER

Dear Customers,

Metro Water Services places the highest value on providing our community with safe, high quality drinking water. MWS employees work vigilantly to treat and monitor water for substances and water qualities that could affect safety, taste, odor and appearance – all so you can trust your tap. Constant testing ensures that Nashville’s water goes above and beyond compliance required by state and



federal standards. As a department of the Metropolitan Government of Nashville & Davidson County, we service over 204,000 water accounts, providing drinking water to customers in Davidson County and portions of Rutherford and Williamson counties. MWS takes pride in the water we serve to our community, friends and family. MWS is pleased to deliver the 2020 Consumer Confidence Report. For more information about Metro Water Services and the quality of your water, visit water.nashville.gov.

Sincerely,

Handwritten signature of Scott Potter in blue ink.

Scott Potter, P.E., Director

AWARD-WINNING OPERATIONS

OMOHUNDRO WATER TREATMENT PLANT

The Omohundro Campus Substation and Generation Facility received the ACEC Tennessee Engineering Excellence Grand Award for design and construction of the \$43.2 million dollar Omohundro Campus Substation and Generation Facility Project.

METRO WATER SERVICES STORMWATER

WEF has recognized the MWS Stormwater division as the Overall Winner of the 2019 Municipal Separate Storm Sewer System (MS4) award, for exceeding regulatory requirements by using the most innovative; effective; and cost efficient approaches to stormwater program management.





NASHVILLE'S TAP WATER

LOCAL

TREATED

FILTERED

TESTED

DELIVERED



water.nashville.gov

ABOUT THE CUMBERLAND RIVER

The Tennessee Department of Environment and Conservation (TDEC) has prepared a Source Water Assessment Program (SWAP) Report for the untreated water sources serving this water system. A copy of the Water Assessment Report will be available for review at Metro Water's Administrative Library, located at 1600 Second Ave. North. A source water assessment summary is available at <https://www.tn.gov/environment/program-areas/wr-water-resources/water-quality/source-water-assessment.html>. The Cumberland River Source is rated highly susceptible to potential contamination. Metro Water Services has two water treatment plants and has the ability to withdraw water from more than one river level to minimize the chance of contamination.

CRYPTOSPORIDIUM - No cryptosporidium oocysts were detected in untreated river water during the last testing done in 2016. EPA/CDC guidelines on appropriate means to lessen the risk of infection by cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline at 1-800-426-4791.

ON-SITE GENERATION OF BLEACH

We use a new, safer, disinfection technology – On-Site Generation of Bleach (OSG). We mix salt with water to create a brine, which passes through an electrical cell to produce chlorine bleach. This new technology replaces the use, transport, and storage of chlorine gas, and makes our community and our workplaces safer.

ABOVE AND BEYOND

WATER TREATMENT PROCESS

LOCAL Water is collected from the Cumberland River and screened for twigs and other large debris before entering one of our two treatment plants, K.R. Harrington and Omohundro.

TREATED In the treatment plant we add alum, a chemical that makes the small particles of mud and algae stick together. These clumps of mud get larger until they are heavy enough to sink to the bottom of the tank. This is called coagulation, flocculation, and sedimentation.

FILTERED The clear water on top of the tank is sent through our filters to remove any remaining particles, leaving the water crystal clear. We use a small amount of bleach to kill harmful bacteria and disinfect the water. We also add a small amount of fluoride, as endorsed by the Metro Health Department, to help prevent tooth decay.

TESTED We test our water regularly before, during and after the treatment process to ensure that our customers receive clean, safe drinking water.

DELIVERED We deliver clean, safe water to over 204,000 customers throughout Metropolitan Nashville and Davidson County. We maintain over 3,000 miles of water pipes, 56 water pumping stations, and 37 reservoirs. Our crews work 24/7/365 to make sure you always have safe water at your tap.

WATER QUALITY TESTING

Metro Water Services is required by state and federal regulations to test for specified unregulated organic and inorganic chemicals. This testing has been performed and reported. All results are available for public inspection at the Metro Water Services Analytical Research Laboratory, 1450 Lebanon Pike. For more information, please contact the MWS Lab at (615) 862-4591 or visit our Web site at water.nashville.gov.

WATER SYSTEM
TN0000494
RECEIVED
ZERO DRINKING
WATER
VIOLATIONS IN
2019.

STATE OF THE ART LABORATORY

Metro Water Services is committed to the protection of public health and our scientists regularly monitor for the presence of unregulated constituents such as Microplastics and PFAS, even when not required.

MWS voluntarily tests our drinking water at both water treatment plants for microplastics and we are pleased to report there is no detection of microplastics in our drinking water.

Voluntary tests for PFAS show that we do not have a PFAS issue. Our testing found no detectable levels or minute levels, well below reporting limits, of PFAS in drinking water when it left our treatment plants.



ABBREVIATIONS AND TERMS USED IN THIS REPORT

MCL (MAXIMUM CONTAMINANT LEVEL): The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG (MAXIMUM CONTAMINANT LEVEL GOAL): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

TT (TREATMENT TECHNIQUE): A required process intended to reduce the level of a contaminant in drinking water.

(MG/L): Milligrams per Liter or parts per million.

(µG/L): Micrograms per Liter or parts per billion.

AL (ACTION LEVEL): The concentration of a contaminant that, if exceeded, triggers treatment or other requirements that a water system must follow.

NTU (NEPHELOMETRIC TURBIDITY UNITS): Standard units for measurement of water clarity.

MRDL (MAXIMUM RESIDUAL DISINFECTANT LEVEL): The highest level of a disinfectant allowed in drinking water.

MRDLG (MAXIMUM RESIDUAL DISINFECTANT LEVEL GOAL): The level of a drinking water disinfectant below which there is no known or expected risk to health.

LEAD LEVELS » If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Metro Water Services is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your drinking water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at www.epa.gov/lead.

2019 WATER QUALITY DATA

Metro Water Services tests for 105 substances that may be present in drinking water. The table below shows those substances that were detected January 1 through December 31, 2019. If you would like a complete list of all substances for which we test, please call (615) 862-4494 to request a Water Quality Letter, or visit our Web site at water.nashville.gov.

REGULATED AT THE WATER TREATMENT PLANT					
Parameter and Units of Measure	Highest Average Level Detected	Range of Levels Detected in 2019	MCL	MCLG	Major Sources of the Substance
Fluoride (mg/L)	0.65	0.48 - 0.80	4	4	Water additive that promotes strong teeth
Nitrate (mg/L)	0.464	0.457 - 0.478	10	10	Runoff from fertilizer use
Sodium (mg/L)	12.2	11.5 - 12.9	N/A	N/A	Natural deposit erosion
Turbidity (NTU)	0.05	0.02 - 0.71	TT = 1 NTU	0	Natural river sediment. Turbidity is a measurement of water clarity, which aids in determining the effectiveness of our filters.
	99.95%	N/A	TT = % of samples < 0.3 NTU		
REGULATED IN THE DISTRIBUTION SYSTEM					
E. coli	0**	N/A	0	0	Human and animal fecal waste
Total Trihalomethanes (THM) (µg/L)	41.6*	12.3 - 60.2	80	N/A	Disinfection chemical (chlorine) combining with organic matter in the river water
Total Haloacetic Acids (HAA) (µg/L)	35.3*	13.6 - 43.7	60	N/A	
Chlorine (mg/L)	1.64	0.8 - 2.9	MRDL - 4	MRDLG - 4	Water additive used to control microbes
Total Organic Carbon (mg/L)	N/A	N/A	TT	N/A	Naturally present in the environment

REGULATED AT THE CUSTOMER'S TAP					
Parameter	90th Percentile	Sites Exceeding AL	MCL	MCLG	Major Sources of the Substance
Copper † (2019 analyses) (ppm)	0.140	0 of 52	AL = 1.3	1.3	Corrosion of household plumbing systems
Lead † (2019 analyses) (ppb)	1.6	0 of 52	AL = 15	0	

* Sampling Conducted within the water distribution system at various State approved locations. Results shown are the Highest Locational Running Annual Average (LRAA), calculated quarterly for all samples taken.

** Number of Samples Resulting in "Presence" detection.

† New Laboratory instrumentation that can detect levels ten times lower than previous Lead and Copper sampling events was utilized in the 2019 triennial sampling event.

A MESSAGE FOR VULNERABLE POPULATIONS

Drinking water, including bottled water, may reasonably be expected to contain small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk.

To ensure that tap water is safe to drink, the EPA prescribes regulations that limit the amount of certain impurities in water provided by public water systems. The Food and Drug Administration regulates bottled water.

The sources of drinking water (both tap water and bottled water) include lakes, streams, ponds, reservoirs, springs, wells, and, in Nashville's case, the Cumberland River. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals, and can pick up substances resulting from the presence of animals or from human activity.

Some people may be more vulnerable to impurities in drinking water than the general population. Immuno-compromised persons such as cancer patients undergoing chemotherapy, those who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at-risk for infection. These people should seek advice from their health care providers about drinking water.

Impurities that may be present in source water include:

- Microbial contaminants, such as viruses and bacteria, which may come from septic systems, sewage treatment plants, agricultural livestock operations and wildlife.
- Inorganic contaminants, such as salts and metals, which can be naturally occurring or result from urban storm run-off, industrial or domestic wastewater discharges, oil and gas production, mining or farming.
- Pesticides and herbicides, which may come from a variety of sources such as agriculture, storm water run-off and residential uses.
- Organic chemicals, including synthetic and volatile organics, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban storm water run-off and septic systems.
- Radioactive contaminants, which can be naturally-occurring or be the result of oil and gas production and mining activities.

More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's Safe Drinking Water Hotline at 1-800-426-4791.



EVERY DAY, SEVEN DAYS A WEEK, SAMPLES OF RIVER, TREATED, AND FINISHED WATER ARE TESTED IN OUR STATE OF THE ART LABORATORIES TO ENSURE THE HIGHEST QUALITY FOR OUR CUSTOMERS.

PREVENTING LEAD IN DRINKING WATER

WHERE IS LEAD FOUND IN THE HOME?

Homes built prior to 1978 often contain lead-based paint. When lead paint fails, it can chip or create dust, which can then be ingested. **Lead paint is the most common source of lead exposure in children.**

Lead pipes and service lines were common in homes until the mid-1950s. The practice was federally banned in 1986, but lead was still used as a soldering material for copper pipe until 1988. Brass fixtures may also contain trace amounts of lead.

HOW DOES LEAD ENTER MY DRINKING WATER?

Nashville's drinking water does not contain lead when it leaves the treatment plants, but tap water can accumulate trace amounts of lead through the corrosion of lead plumbing materials. MWS regularly tests for lead in the drinking water at a selected number of lead service line locations. The EPA requires tested levels be below 15 parts per billion (ppb).

CONTROLLING CORROSION

Since 1987, MWS has had an intense corrosion control program to prevent the possibility of lead leaching into your water. A blended phosphate solution is added to the finished water and reacts to inhibit corrosion of water mains; tie-up nuisance metals; and remove scale deposits in pipes by bonding to the walls and forming a protective barrier.


HOW DO I KNOW IF I HAVE LEAD PLUMBING?

Identify the color of your pipes, lead is generally a dull gray. Carefully scratch the pipe with a key. If the pipe is made of lead, the area you've scratched will turn a bright silver color. *Do not use a knife or other sharp instrument and take care not to cut or puncture a hole in the pipe.*

WHAT ARE THE RISKS OF LEAD EXPOSURE?

Lead exposure can cause adverse health effects including increases in blood pressure of some adults; delays in normal physical and mental development in babies and young children; and, deficits in the attention span, hearing, and learning abilities of children.

REDUCE YOUR RISK

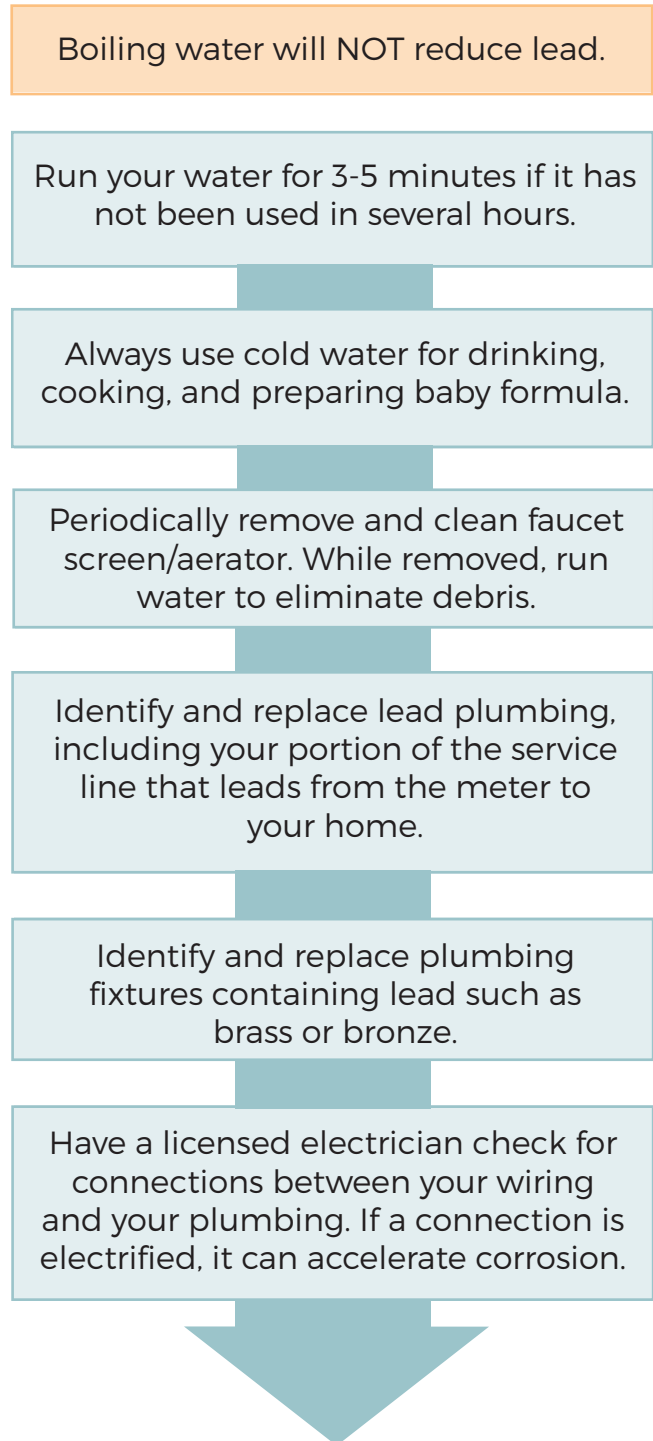

For more information about lead, visit our website and download our "Preventing Lead In Drinking Water" brochure at bit.ly/MWSLead



LOOKING TO THE FUTURE

UTILIZING SOLAR POWER

In 2019 Metro Water Services initiated a plan to utilize solar power at the Whites Creek Wastewater Treatment Plant, Omohundro South and Central Wastewater

Treatment Plant. This plan will install a total of 1.7 megawatts of solar power generating capacity at the three facilities. This will generate over 2 gigawatt hours of electricity annually avoiding nearly 2,000 tons of greenhouse gas emissions. The MWS stormwater division has completed the design for a Mansker Creek Bank Stabilization Project utilizing bioengineering methods to prevent future erosion and sediment loss to the impaired waterway, as well as to prevent the potential damage to a nearby sanitary sewer main. This project will protect the environment as well as vital infrastructure.

ENVIRONMENTAL PROTECTION

The MWS stormwater division has completed the design for a Mansker Creek Bank Stabilization Project utilizing bioengineering methods to prevent future erosion and sediment loss to the impaired waterway, as well as to prevent the potential damage to a nearby sanitary sewer main. This project will protect the environment as well as vital infrastructure.

COMMUNITY EDUCATION

In addition to inviting Nashvillians to take a first-hand look at how we provide clean, safe drinking water every day on tours of our K.R. Harrington Water Treatment Plant and how we treat the returned water at our Whites Creek Water Reclamation Facility and Biosolids Facility, we also offer Virtual Tours for adults and students of all ages. Students and teachers can attend our Virtual Classes and learn on their own time. We are pleased to make our facilities accessible to all.

ENSURING RESILIENCY

Completion of the Omohundro Campus Substation and Generation Facility Project provides 10 megawatts (MW) of standby and continuous run generators for backup power to the Omohundro Water Treatment Plant, Omohundro South, and adjacent Clean Water Nashville equalization facilities. The new infrastructure allows MWS to supply drinking water to customers even during electrical power outages.

QUESTIONS

For questions about billing, to start or change water service, or if you have a water, sewer, or stormwater emergency, contact Metro Water Services at (615) 862-4600.

If you have questions about this report, contact Metro Water Services at (615) 862-4494.

Este informe contiene información muy importante sobre su agua beber. Tradúzcalo ó hable con alguien que lo entienda bien.

HOW YOU CAN BE INVOLVED

The public may participate in decisions concerning water quality by attending the Metropolitan Council meetings held on the first and third Tuesdays of each month at the Metro Courthouse, One Public Square.

ADA INFORMATION

If you need assistance or an accommodation, please contact the Safety Office at 1600 Second Ave. North, Nashville, TN 37208 or (615) 862-4862.



WATER.NASHVILLE.GOV