

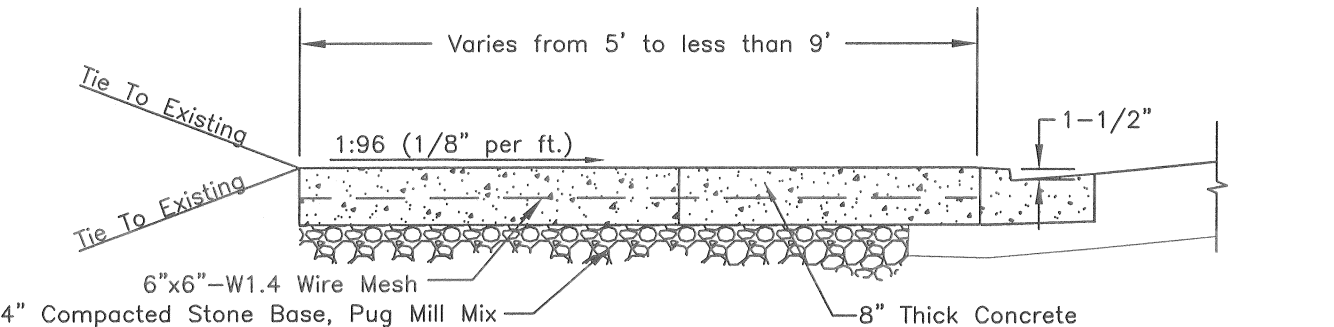


PLAN VIEW

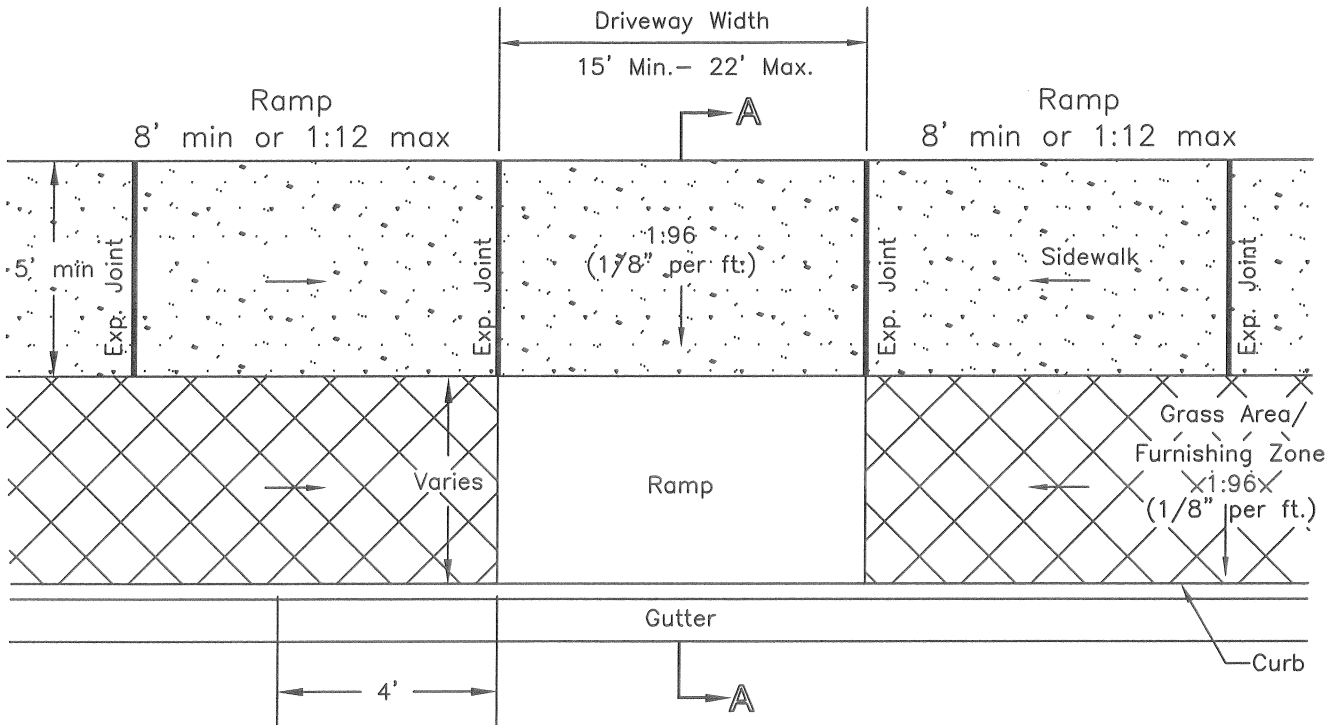

SECTION A-A

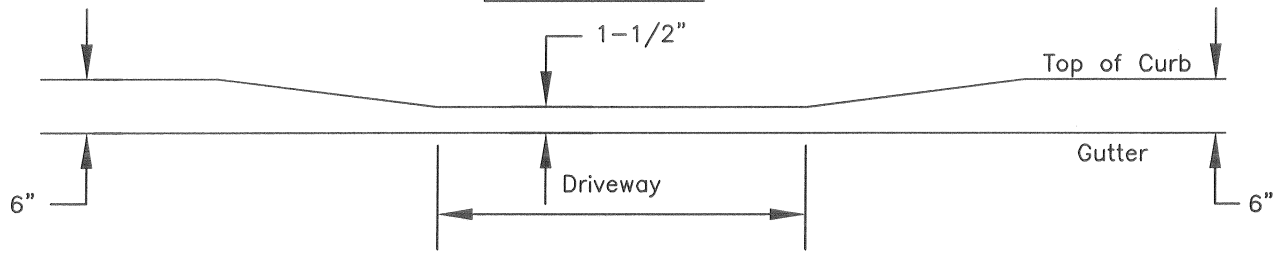

CURB TAPER FOR DRIVEWAY RAMP

- NOTE:
1. Cross-slope of sidewalk shall not exceed 1:48 (vertical:horizontal).
 2. Fiber mesh reinforcement is an approved alternative for the wire mesh. Fiber mesh reinforcement will be added to the concrete at the batch plant at the rate of 1 1/2 pounds per cubic yard.
 3. Concrete shall be 8 inches thick.

NOT TO SCALE

METROPOLITAN GOVERNMENT OF NASHVILLE AND DAVIDSON COUNTY DEPARTMENT OF PUBLIC WORKS	ALTERATION CONSTRUCTION COMMERCIAL DRIVEWAY RAMP WITH SIDEWALK LESS THAN 9 FEET	DWG. NO. ST-325
DIR. OF ENG.: <i>Mark Macy</i>	DATE: <i>5/12/03</i>	REVISED: 01/27/03 REVISED: 05/08/03 REVISED: