

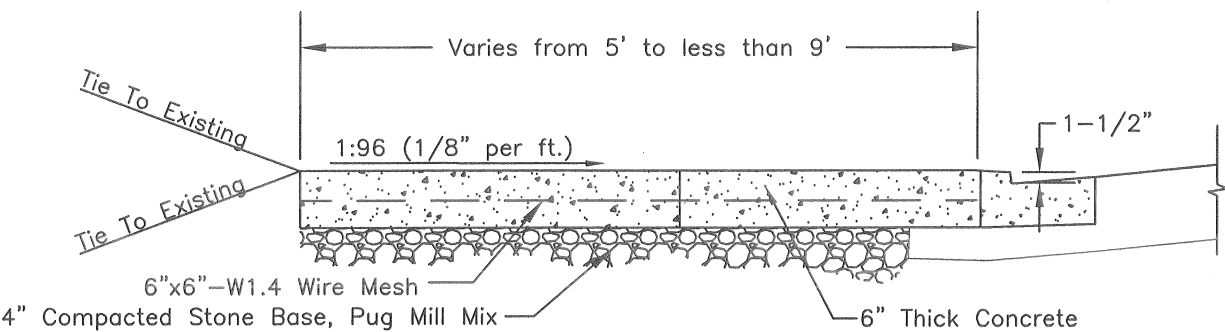


**PLAN VIEW**

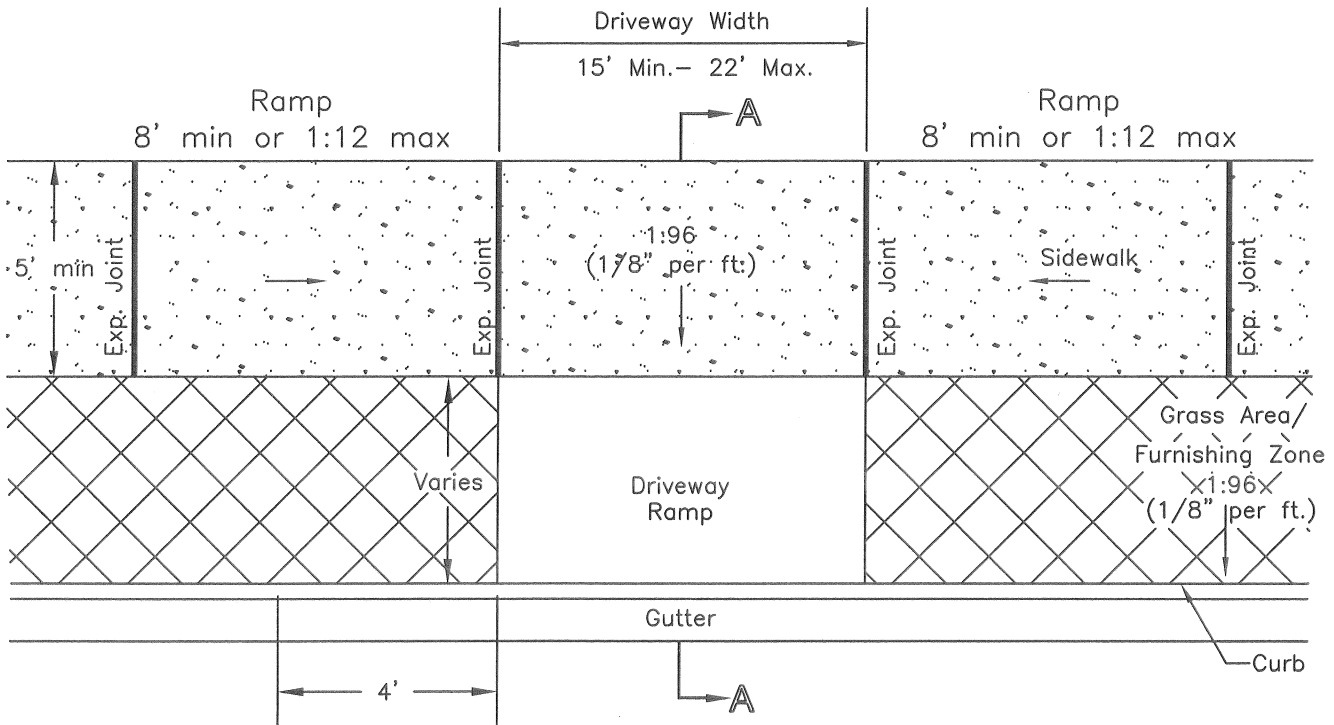

**SECTION A-A**

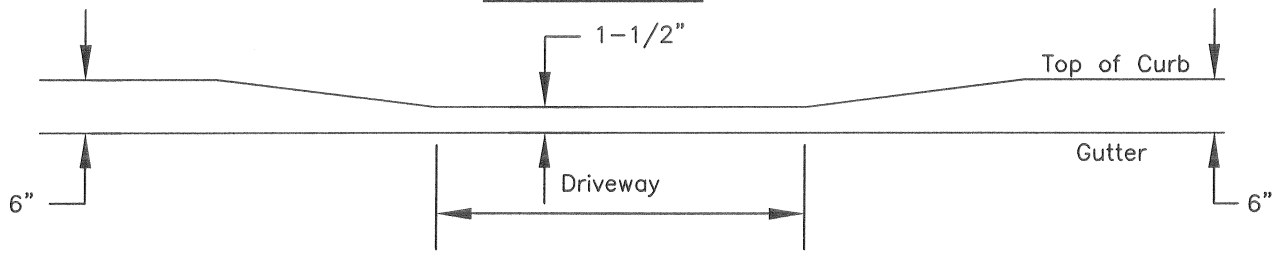

**CURB TAPER FOR DRIVEWAY RAMP**

- NOTE:
1. Cross-slope of sidewalk shall not exceed 1:48 (vertical:horizontal).
  2. Fiber mesh reinforcement is an approved alternative for the wire mesh. Fiber mesh reinforcement will be added to the concrete at the batch plant at the rate of 1 1/2 pounds per cubic yard.
  3. Concrete shall be 6 inches thick.

NOT TO SCALE

METROPOLITAN GOVERNMENT OF NASHVILLE AND DAVIDSON COUNTY DEPARTMENT OF PUBLIC WORKS	ALTERATION CONSTRUCTION RESIDENTIAL DRIVEWAY RAMP WITH SIDEWALK LESS THAN 9 FEET	DWG. NO. ST-323
DIR. OF ENG.: <i>Markus May</i>	DATE: <i>5/12/03</i>	REVISED: 01/27/03 REVISED: 05/08/03 REVISED: